



April 8, 2019

RE: WASTEWATER SYSTEM IMPROVEMENTS
OUR HOME, INC.
HURON, SOUTH DAKOTA
SPN # M 15029

BID LETTING: THURSDAY, APRIL 18, 2019, 2:00 PM

ADDENDUM NUMBER 1

The following modifications are to be made to the plans and specifications for the Wastewater System Improvements Project.

SPECIFICATIONS

SECTION 33 32 13.16 – DUPLEX GRINDER PUMPING STATION, PART 2.05- CONTROLS, SUBPART A, ADD ITEM 21 TO READ:

21. A run light will be mounted on the outside of the panel adjacent to the alarm light. The run light will be on when either pump is running. The light will be equipped with a green globe and be same style as the alarm light.

PLANS – WASTEWATER SYSTEM IMPROVEMENTS

PLAN SHEET 6 – DUPLEX GRINDER LIFT STATION DETAILS

See attached Plan Sheet 6 with the following revisions:

1. Diameter of wet well and valve vault was revised to 72-inches for the inside diameter of both structures
2. Type II cover on wet well revised to an O.D. diameter of 100-inches.
3. Wet well and valve vault bases were revised to an O.D. diameter of 100-inches.
4. Pump access door was revised to 30 inches x 42 inches.
5. Trash basket access door was revised to 12-inches x 24-inches.
6. A green run light was added to the control panel.

No other modifications were made to the plans.





Jay C. Koch, P.E., Project Engineer
Schmucker, Paul, Nohr & Associates

The undersigned hereby acknowledges receipt of Addendum Number 1 to the plans and specifications for the WASTEWATER SYSTEM IMPROVEMENTS.


FIRM NAME _____

BY _____

TITLE _____

DATE _____

ACKNOWLEDGE RECEIPT OF THIS ADDENDUM IN THE BIDDING DOCUMENTS –
ARTICLE 3 AND/OR ATTACH THIS SIGNED ADDENDUM TO THE BID FORM WHEN
SUBMITTING

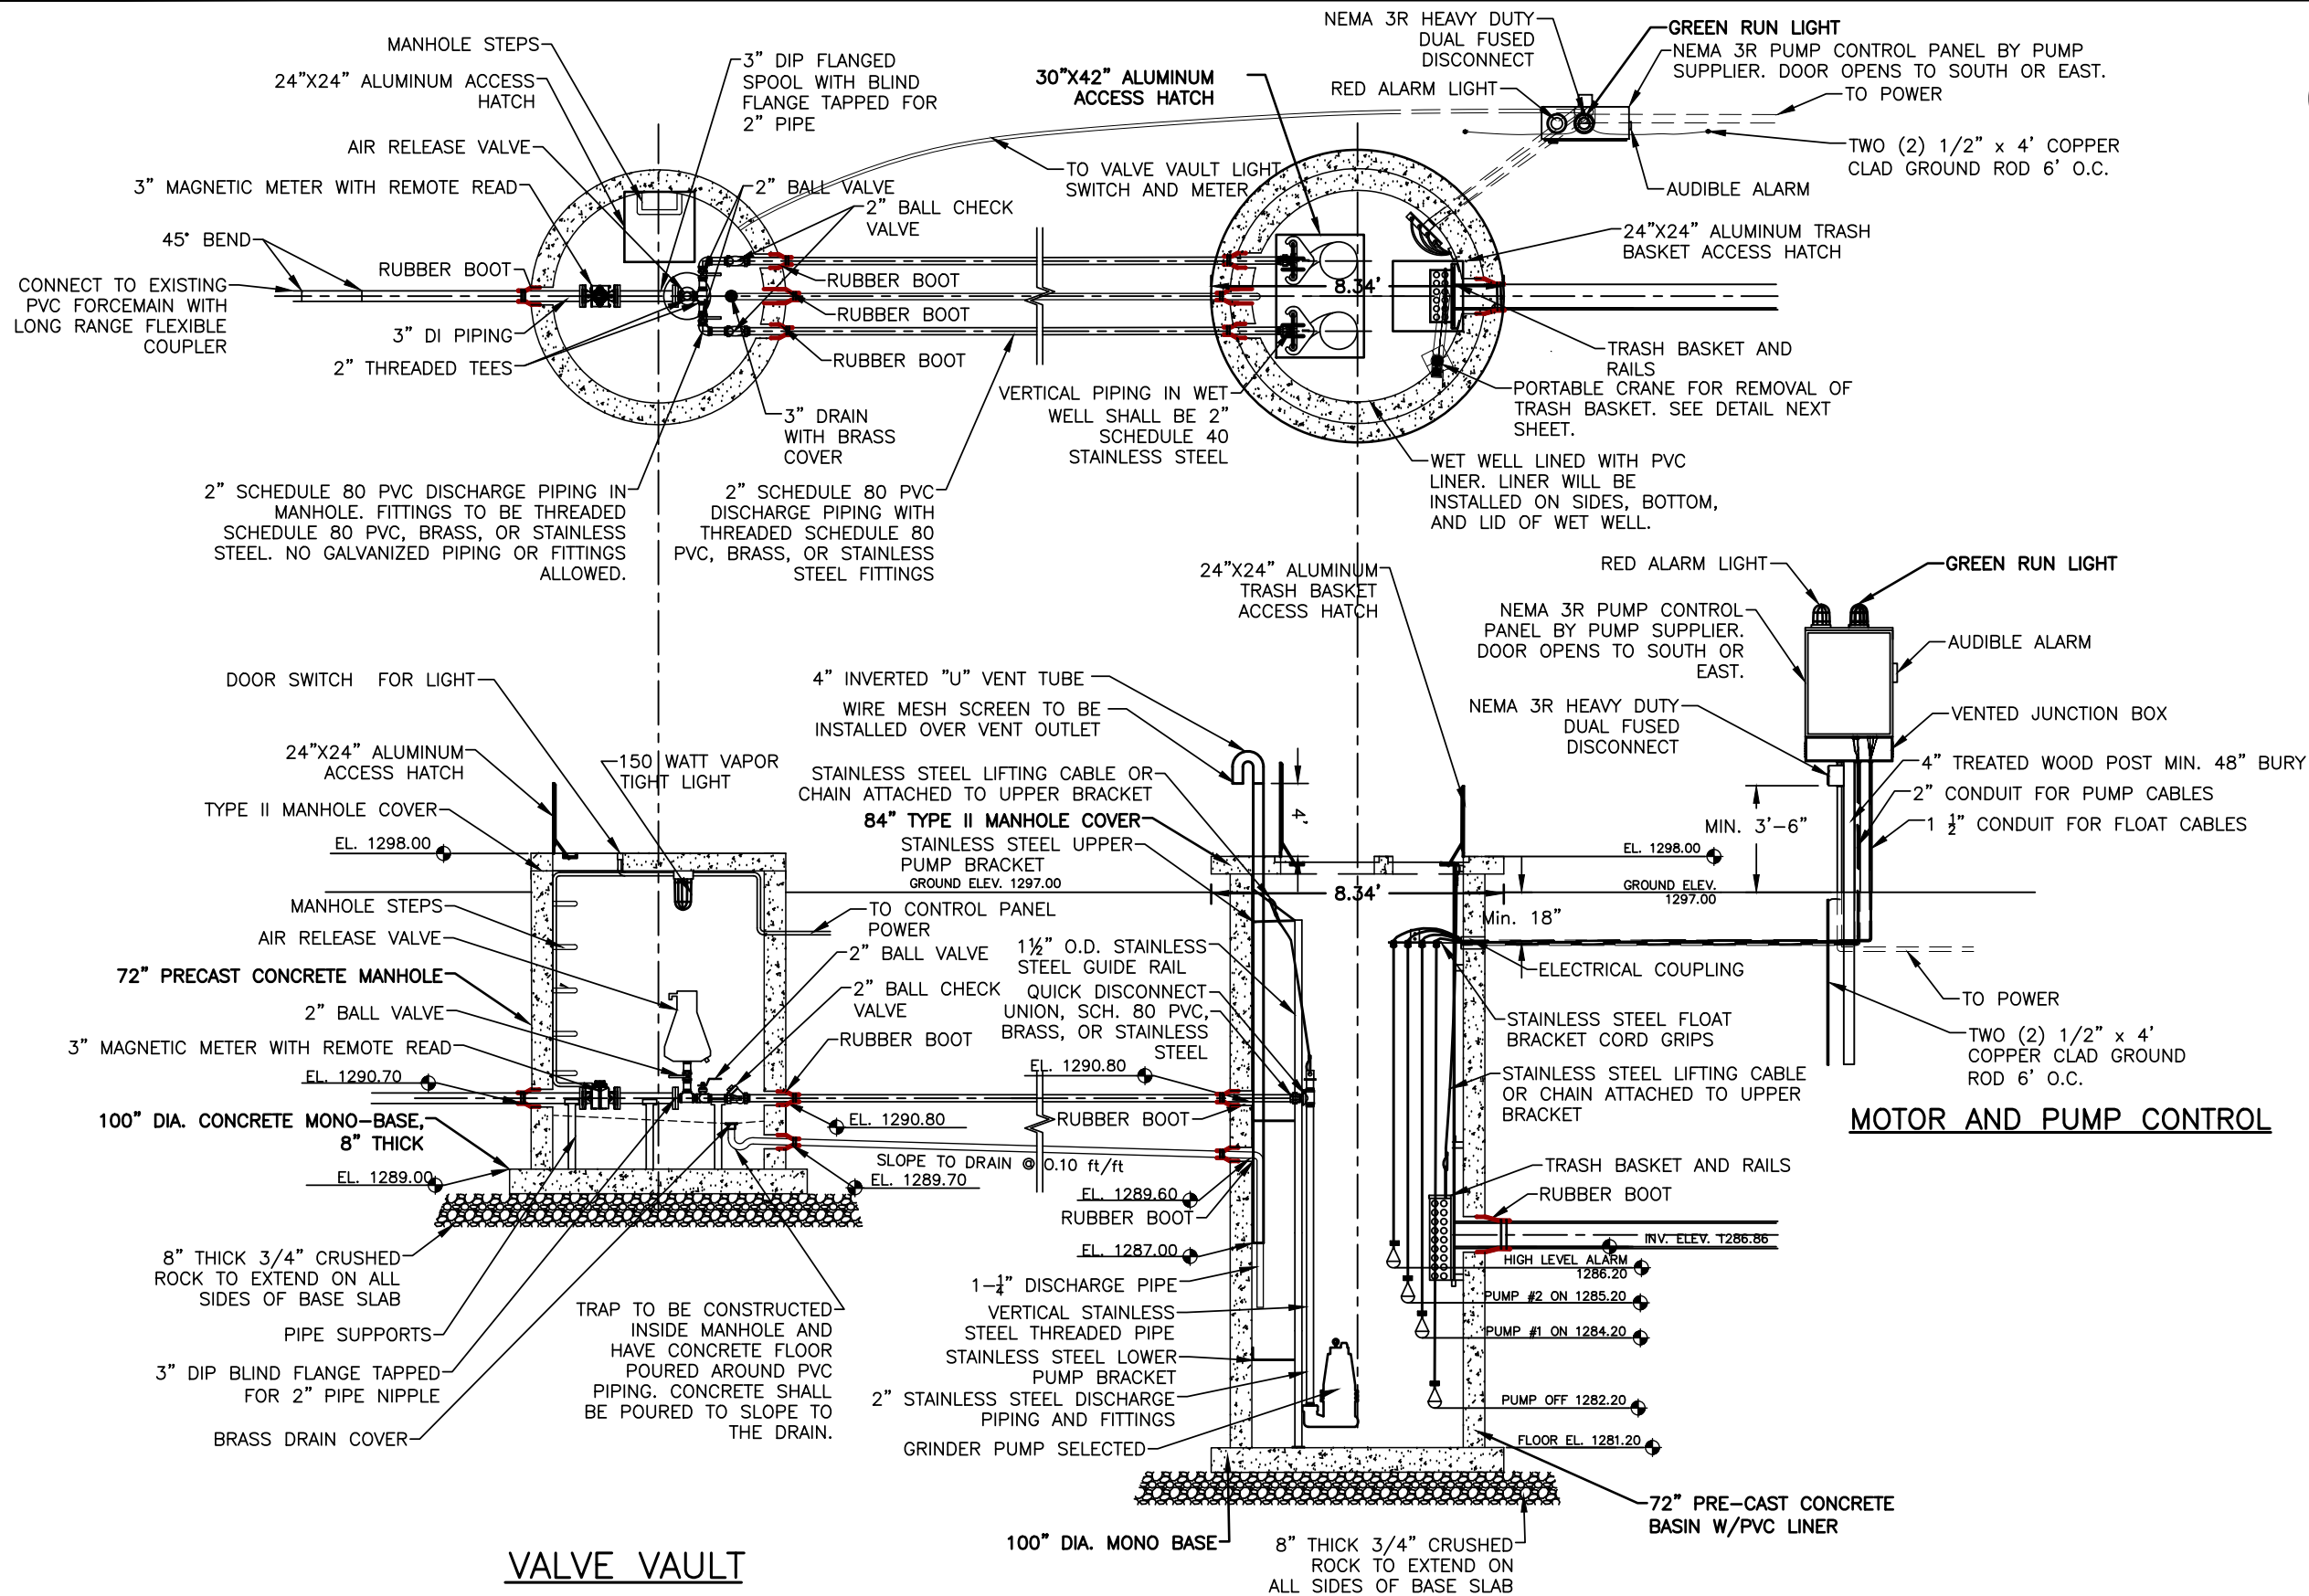

VALVE VAULT

DUPLEX GRINDER LIFT STATION




SPN
& Associates

Engineers - Planners - Surveyors

2100 North Sanborn Boulevard - P.O. Box 398
Mitchell, South Dakota - Zip 57301-0398
Phone: (605) 996-7761 - Fax: (605) 996-0015

Certificate

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of South Dakota.

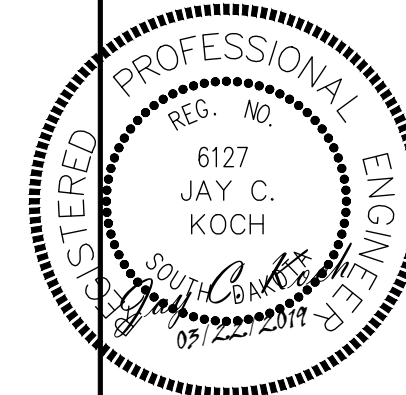

ADDENDUM #1 REVISIONS

Plan Horiz. Scale:	1" = 5'
Drawn By:	DJR
Checked By:	JCK
Date:	03/08/2019
Project No.:	15029
File Name:	15029-OurHome Inc.

Project Name:
Wastewater System Improvements

Located in:
Huron, South Dakota

Sheet Name:
Duplex Grinder Lift Station Detail

Sheet Number:	Total Sheets:
6	8